



**ANNUAL MAXIMUM DEMAND  
PER CLASS OF CUSTOMER**

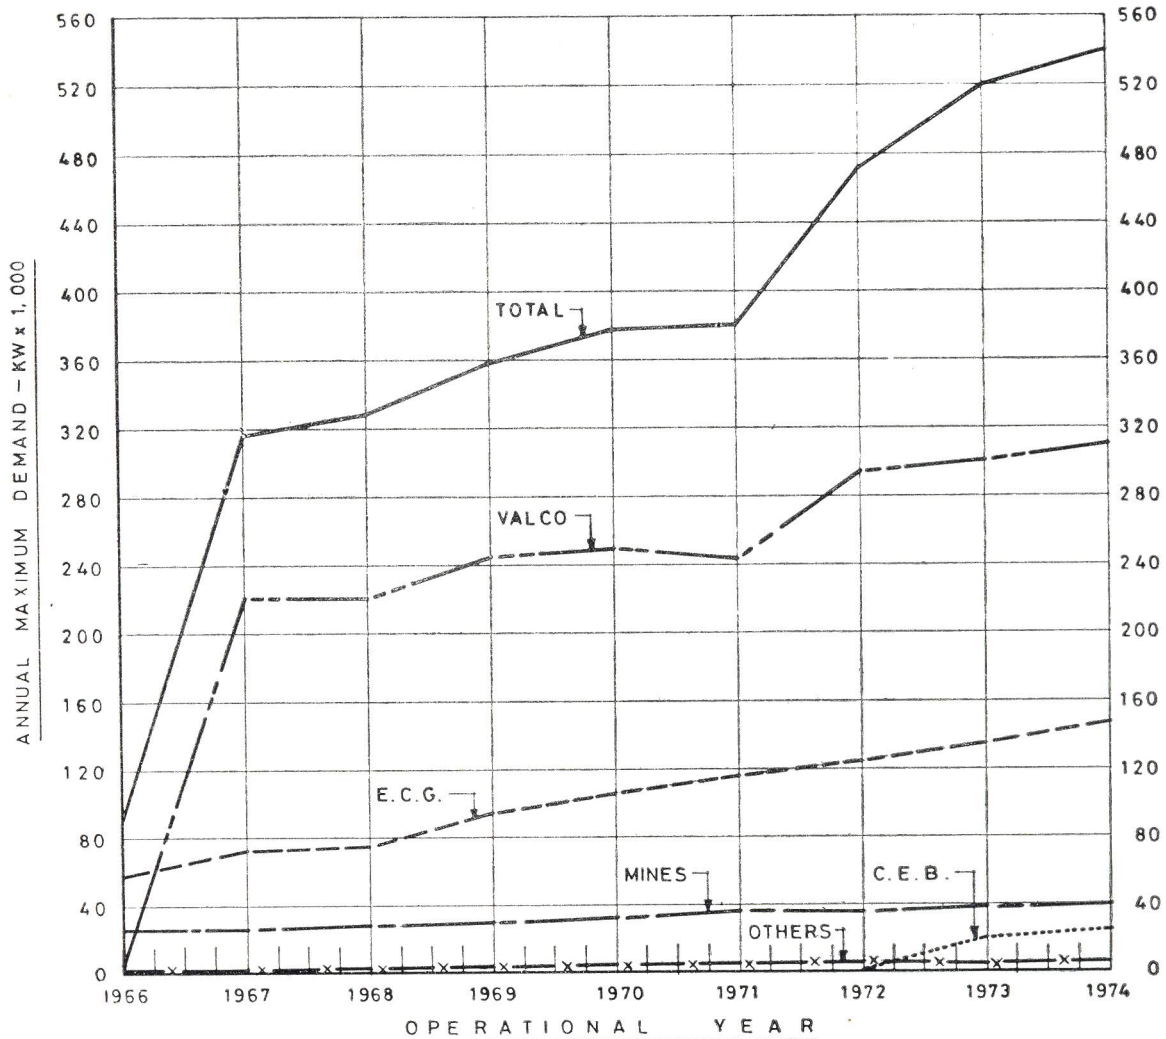

**POWER PRODUCTION STATISTICS ANNUAL MAXIMUM DEMAND IN KW**

	1966	1967	1968	1969	1970	1971	1972	1973	1974
Maximum demand at Akosombo Generating Station	92,000	317,000	329,000	359,000	378,000	380,000	471,000	529,000	540,000
<b>Customer</b>									
Valco (estimate)	5,000	220,500	220,000	245,000	250,000	243,900	295,000	300,000	310,000
E.C.G.	58,600	73,400	75,900	95,700	106,400	117,300	125,605	135,000	146,000
Mines	26,100	27,000	28,500	31,000	33,500	37,100	37,657	38,000	40,000
Akosombo Township	1,400	1,400	1,000	1,000	1,600	1,600	1,678	1,600	1,400
Akosombo Textiles	—	—	1,000	1,800	3,200	3,400	4,800	4,200	4,200
Communaute Electrique du Benin (estimate)	—	—	—	—	—	—	1,000	20,000	24,500

**ANNUAL ENERGY CONSUMED  
PER CLASS OF CUSTOMER**

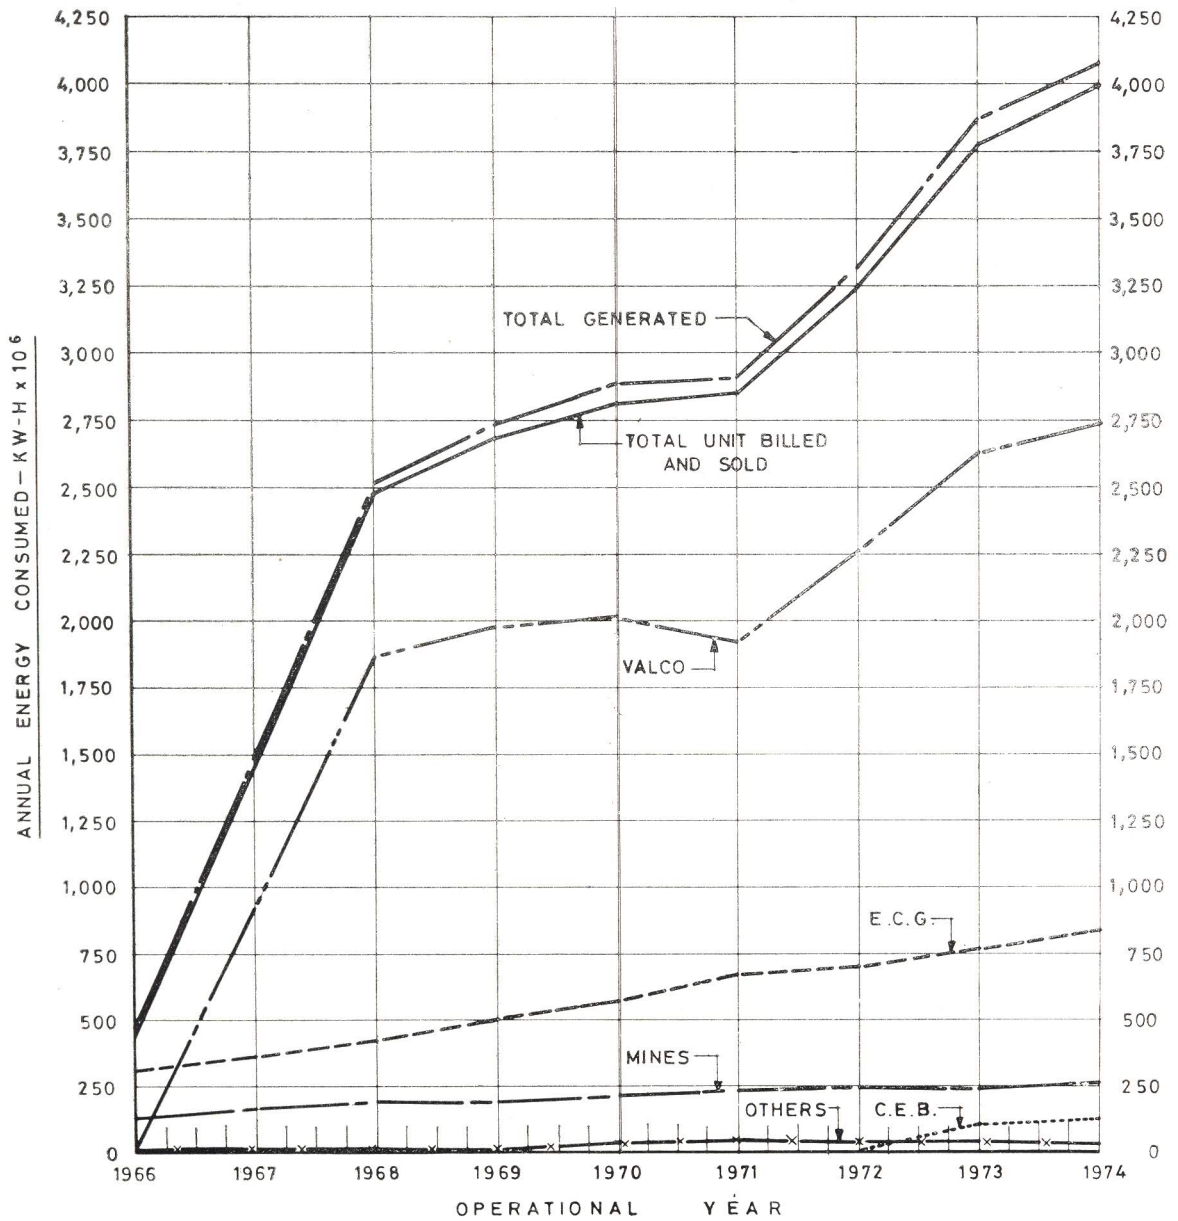

**ANNUAL ENERGY CONSUMED PER CLASS OF CUSTOMER IN 10<sup>3</sup> KWH**

	1966	1967	1968	1969	1970	1971	1972	1973	1974
Total Generated ...	475,600	1,495,400	2,523,600	2,728,500	2,881,000	2,909,290	3,321,230	3,871,560	4,077,950
Total Units Billed and Sold	449,700	1,454,600	2,473,400	2,673,600	2,806,000	2,834,600	3,237,096	3,771,414	3,989,326
<b>Customers</b>									
Valco ... ..	13,900	923,200	1,865,900	1,972,200	2,012,400	1,919,000	2,263,813	2,625,990	2,734,768
E.C.G. ... ..	300,900	360,300	420,100	502,800	564,800	659,250	699,447	768,120	839,455
Mines ... ..	127,200	164,100	177,400	185,500	206,800	226,500	242,639	243,067	256,996
Akosombo Township ...	2,700	6,300	6,800	6,800	7,200	8,809	9,005	12,538	11,058
Akosombo Textiles ...	—	—	2,000	6,300	14,847	20,815	20,935	21,976	19,269
Communaute Electrique du Benin ... ..	—	—	—	—	—	—	1,257	99,723	127,780

